


THIS DOCUMENT IS THE PROPERTY OF KOOLTRONIC, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY KOOLTRONIC, INC.

NOTE: #2, #4 & #7 T-STAT TERMINALS GET 0459-190 TERM. HOUSING COVERS

REV	NOTICE	DESCRIPTION	DATE	APPROVED
-	ER 13/043	NEW DRAWING RELEASE	10/29/13	JS
A	EC 14/050	CHANGED WIRE #20 TERMINAL, VAS -63	2/12/14	JS
B	ER 15/058	ADDED HEATER OPTION "F".	8/4/15	DW
C	EC 18/204	WIRE #64 LENGTH WAS 12".	4/2/18	DW-SDS

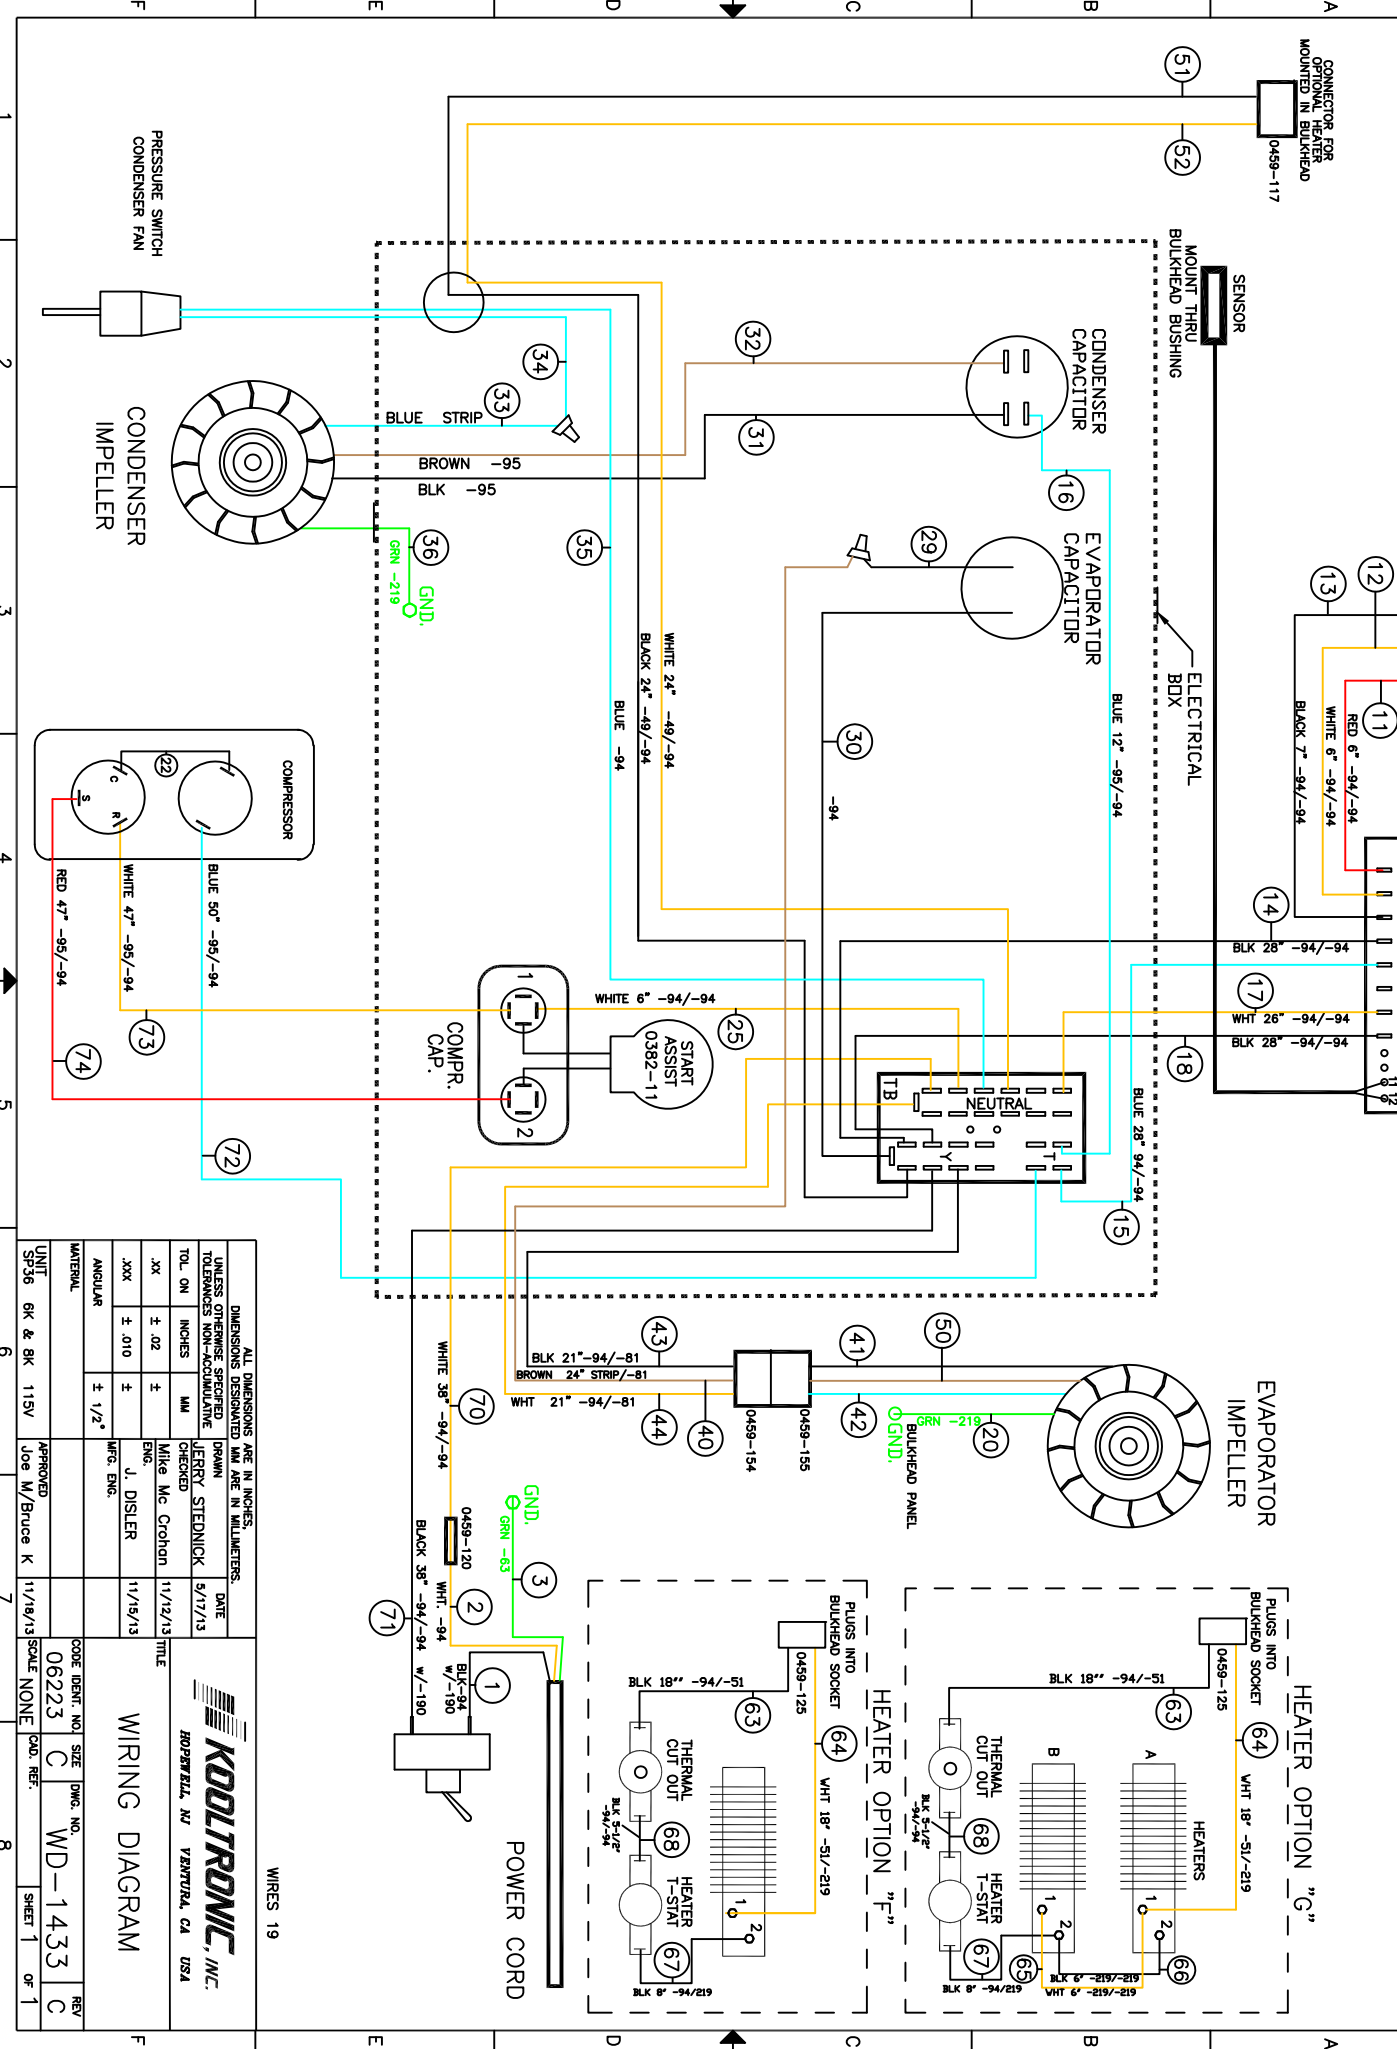

WIRES 19



WIRING DIAGRAM

UNIT	SP36	6K & 8K	115V	APPROVED	DATE	SCALE	SHEET	OF
UNIT	SP36	6K & 8K	115V	Joe M/Bruce K	11/18/13	NONE	1	1

CODE IDENT. NO.	SIZE	DWG. NO.	REV
06223	C	WD-1433	C

TITLE	DATE	APPROVED
WIRING DIAGRAM	11/12/13	Mike Mc Crohan
	5/17/13	JERRY STEDNICK
	11/15/13	J. DISLER
		MFG. ENG.

DIMENSIONS ARE IN INCHES.	
UNLESS OTHERWISE SPECIFIED	PRMNM
TOLERANCES NON-ACCUMULATIVE	JERRY STEDNICK
TOL. ON INCHES	MM
XX ± .02	±
.XXX ± .010	±
ANGULAR	± 1/2°