


THIS DOCUMENT IS THE PROPERTY OF KOOLTRONIC, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY KOOLTRONIC, INC.

NOTE: #2, #4 & #7 T-STAT TERMINALS GET 0459-190 TERM. HOUSING COVERS

REV	NOTICE	DESCRIPTION	DATE	APPROVED
-	ER 13/046	NEW DRAWING RELEASE	2/6/14	JS
A	EC 15/059	CHANGED WIRE #35 46" STRIP/STRIP	2/24/15	JS
B	ER 17/047	ADDED "GT" OPTION TO DRAWING	8/18/17	SDS/
C	EC 17/490	REMOVED HEATER OPTION	10-06-17	JS/SDS
D	EC 18/074	CHANGED WIRE POSITIONS IN JUNCTION BOX	2-23-18	JS/SDS

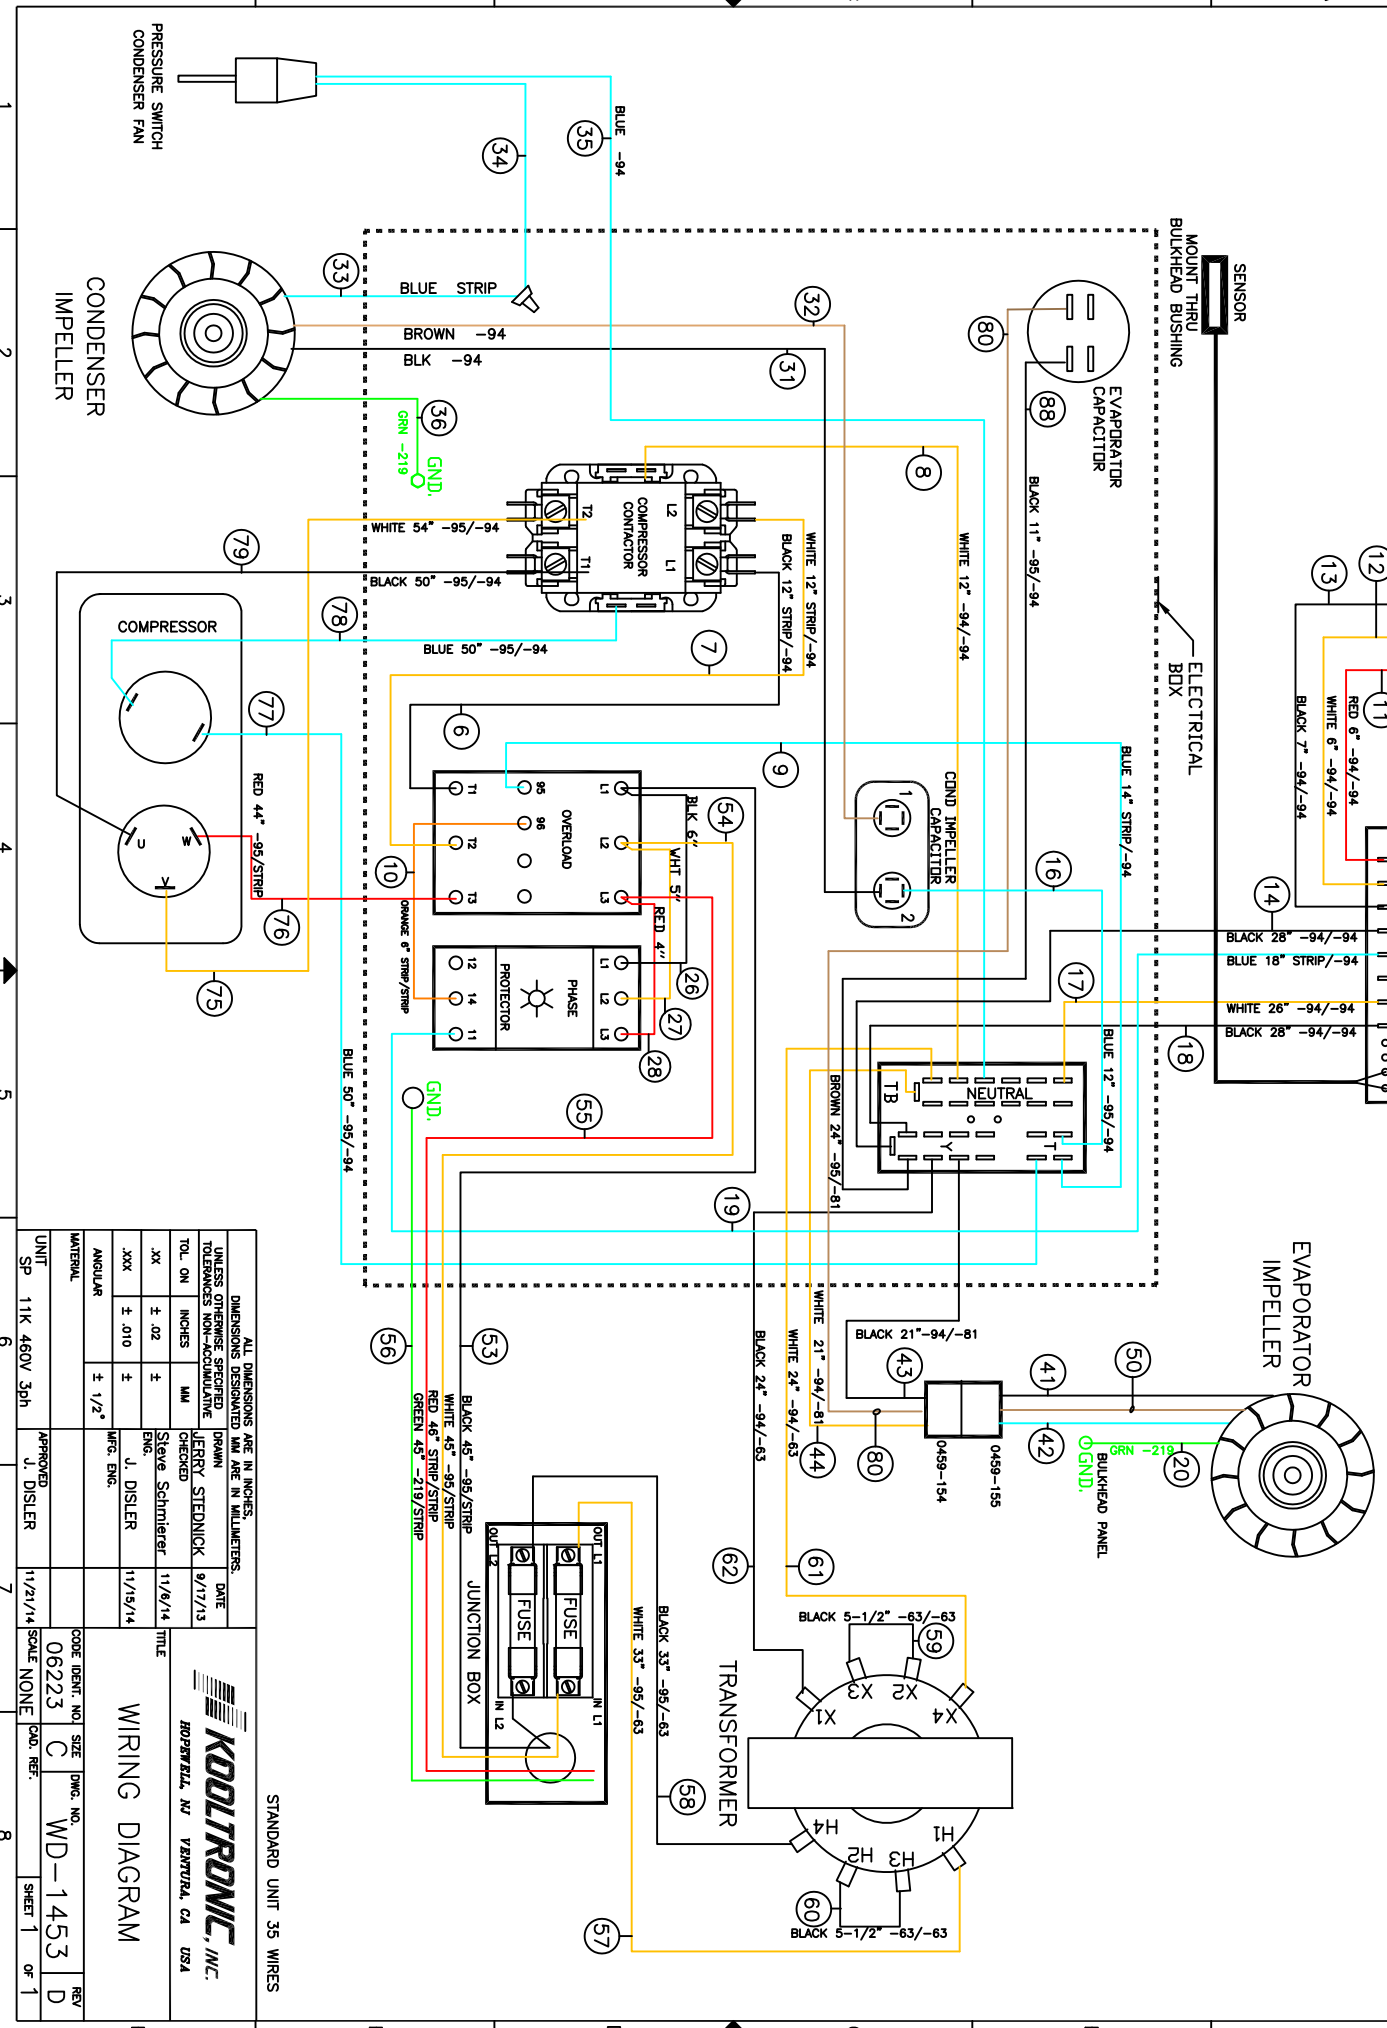

STANDARD UNIT 35 WIRES



ROPERBEL, NJ VENTURA, CA USA

WIRING DIAGRAM

<p>ALL DIMENSIONS ARE IN INCHES, UNLESS OTHERWISE SPECIFIED DRAWN JERRY STEDNICK 9/17/13</p> <p>TOLERANCES NON-ACCUMULATIVE CHECKED Steve Schmitzler 11/8/14</p> <p>DATE 11/8/14</p>		<p>DATE 11/15/14</p> <p>ENGINEER J. DISLER 11/15/14</p> <p>CHECKED J. DISLER 11/15/14</p> <p>DATE 11/15/14</p>	
<p>APPROVED J. DISLER 11/21/14</p> <p>SCALE NONE</p>		<p>CODE IDENT. NO. 06223</p> <p>SIZE C</p> <p>DWG. NO. WD-1453</p> <p>REV. D</p>	
<p>UNIT SP 11K 460V 3ph</p>		<p>SHEET 1 OF 1</p>	