


THIS DOCUMENT IS THE PROPERTY OF KOOLTRONIC, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED OR DISCLOSED TO OTHERS, EXCEPT AS EXPRESSLY AUTHORIZED IN WRITING BY KOOLTRONIC, INC.



SYM	NOTICE	DESCRIPTION	DATE	APPROVED
-	EC 96/98	NEW DRAWING RELEASE	4/30/96	TJR
A	ER 96/56	ADDED COOLING EFFECT DETECTOR OPTION	4/9/99	RL
B	EC 99/121	REVISED WIRING FROM POWER CORD TO T-BLOCK	5/11/99	ROM
C	EC 99/121	CHANGED WIRING TO RELAY AND MICROALLY	7/13/99	RL
D	EC 99/1	CHANGED RELAY TO 0694-57		
E	EC 01/14	PICTORIALLY CHG. THE COMP. ADDED WIRE LENGTHS, WIRE MARKERS AND TERMINATIONS. RELOCATED CAP. TERM. TO THE OTHER TERMINAL BLOCK.	9/21/99	HRM
F	EC 03/132	CHANGED "T" SIDE WIRES TO BLUE	01/11/01	PSK
G	EC 03/392	"T" ADDED 12" BLUE WIRE FROM COMP. BLWR. CAP. TO T-BLOCK	4/10/03	ROM
H	EC 03/496	CHANGED WHT WIRE FROM 8" TO 6"	7/19/03	SOS
I	EC 05/290	ADDED WIRE TERMINATIONS	10/21/03	SOS
J	EC 06/063	12" BLU WIRE WAS 8 1/2"	7/12/06	SOS
K	EC 06/063	CHANGED BLACK WIRE LENGTH FROM 28" TO 26" BECAUSE OF PREVIOUS CONSULTATION OF WIRS	6/2/06	JS
L	EC 06/274	ADDED 18" WHT -94/-94 WIRE	9/22/08	ROM
M	EC 14/170	REMOVED SURGE SUPPRESSOR	9/17/14	LM/

DRAWN		DATE	
CHECKED		11/5/02	
ENG.		RDM	
MFG. ENG.			
APPROVED		DATE	
BKK		11/5/03	
MATERIAL		TITLE	
KA4C4-7P47R		WIRING DIAGRAM	
APPROVED		AIR CONDITIONER	
BKK		WD-240	
11/5/03		M	

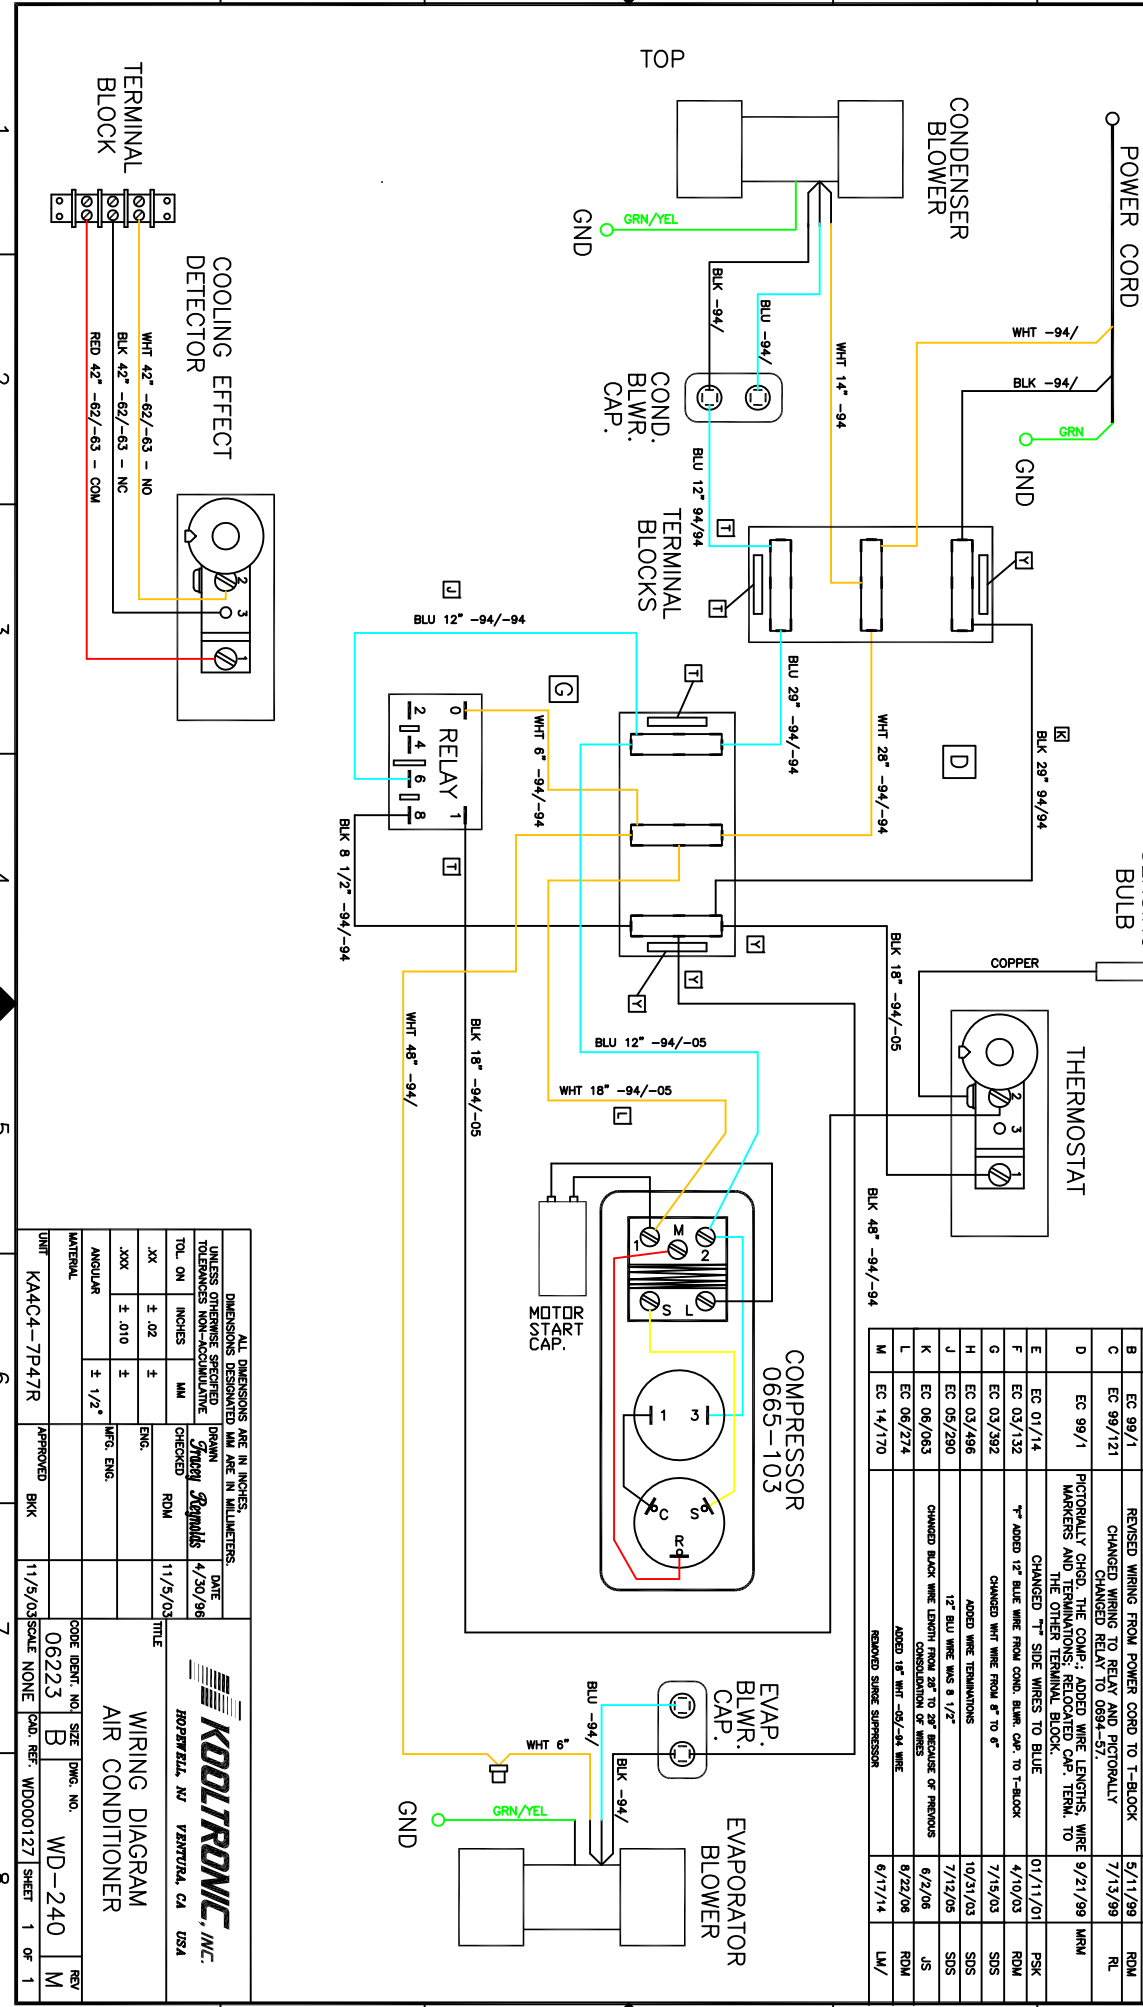

ROPER BELLS, NJ VERBODEN CA USA

1 2 3 4 5 6 7 8

F E D C B A

TOP

CONDENSER BLOWER

COND. BLWR. CAP.

TERMINAL BLOCKS

RELAY

SENSING BULB

THERMOSTAT

COMPRESSOR 0665-103

EVAP. BLWR. CAP.

EVAPORATOR BLOWER

COOLING EFFECT DETECTOR

TERMINAL BLOCK

WHT 42" -62/-63 - NO

BLK 42" -62/-63 - NC

RED 42" -62/-63 - COM

WHT 14" -94

BLU -94/

WHT 12" 94/94

BLU 12" 94/94

WHT 28" -94/-94

BLK 28" 94/94

WHT 6" -94/-94

BLK 8 1/2" -94/-94

WHT 18" -94/-05

BLU 12" -94/-05

WHT 18" -94/-05

BLK 18" -94/-05

WHT 48" -94/

BLK 48" -94/-94

WHT 6" -94/

BLU -94/

BLK -94/

GRN/YEL

GND

GND

COPPER